



GOLDENROD TRAIL

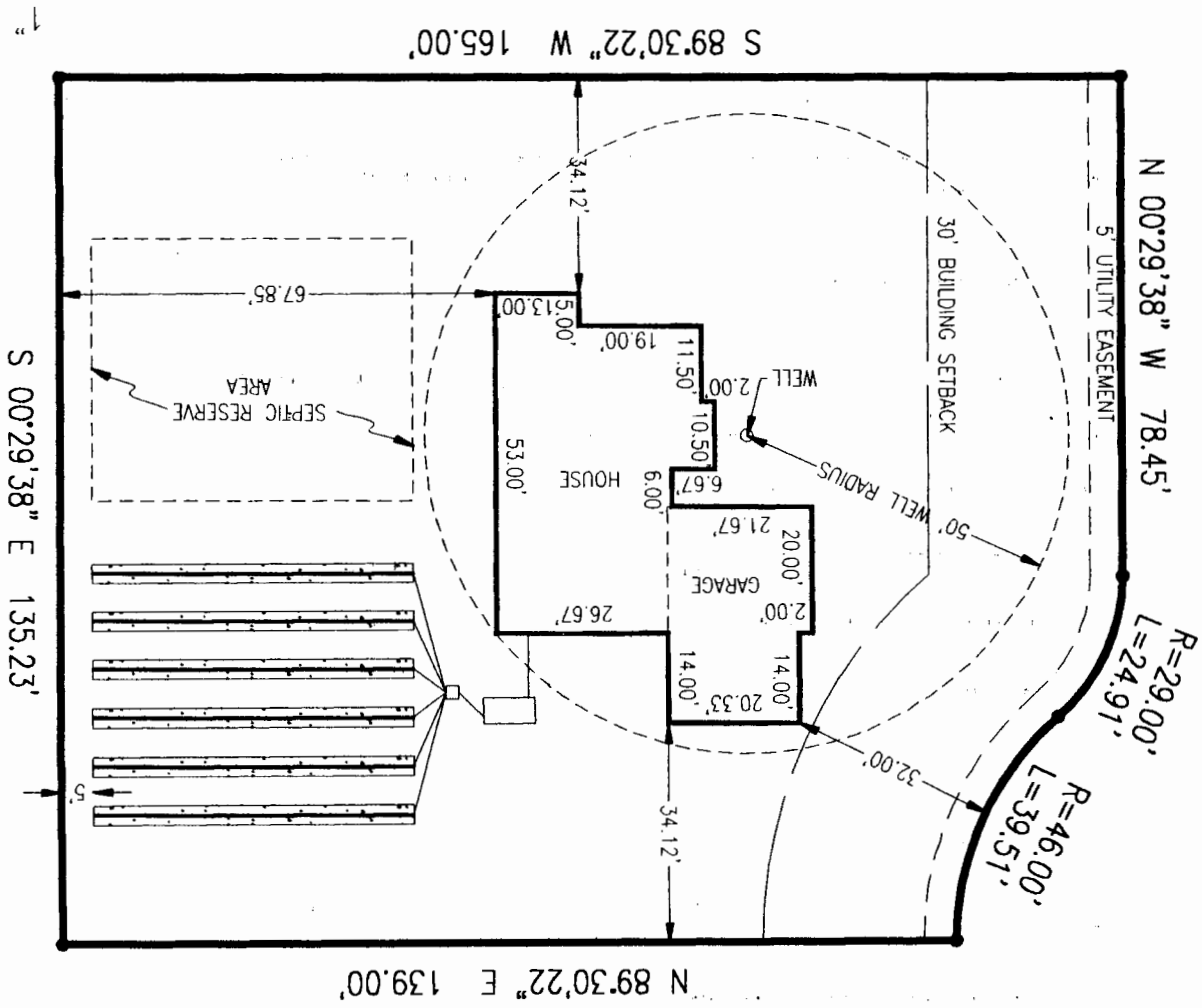


SEPTIC TRENCH DETAIL

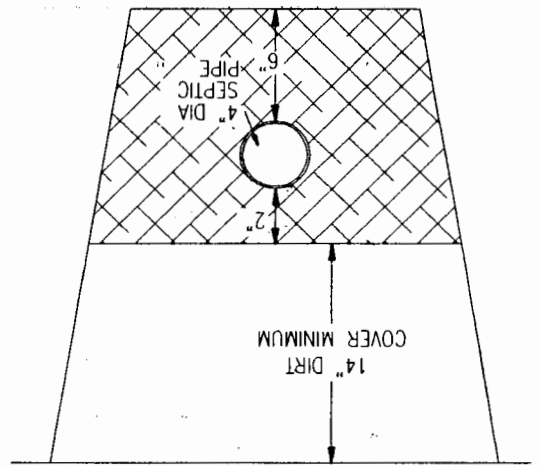

HIDDEN MEADOW EAST  
SECTION THREE  
LOT #144  
FOR  
JRK CONSTRUCTION

SEPTIC STUB DETAIL

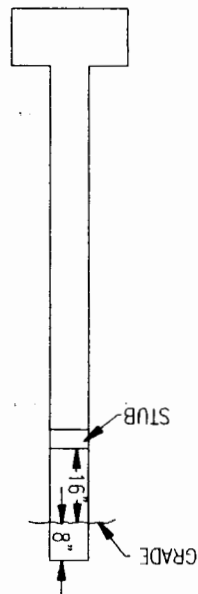

NOTE:  
NO WELLS EXISTING WITHIN  
50' OF PROPERTY LINE  
MINIMUM SEPTIC SYSTEM REQUIREMENTS  
THREE BEDROOM HOUSE  
1000 GALLON SEPTIC TANK  
900 SQUARE FEET FIELD SYSTEM AREA  
300 LINEAR FEET OF TRENCHES  
6 x 50 L.F. OF TRENCHES  
MAXIMUM TRENCH DEPTH: 36 INCHES



1" = 30'